


Spring Flows, Reservoir Water and Treatment Plant Usage  
2017 and 2018 Comparison  
June 23rd through July 22nd

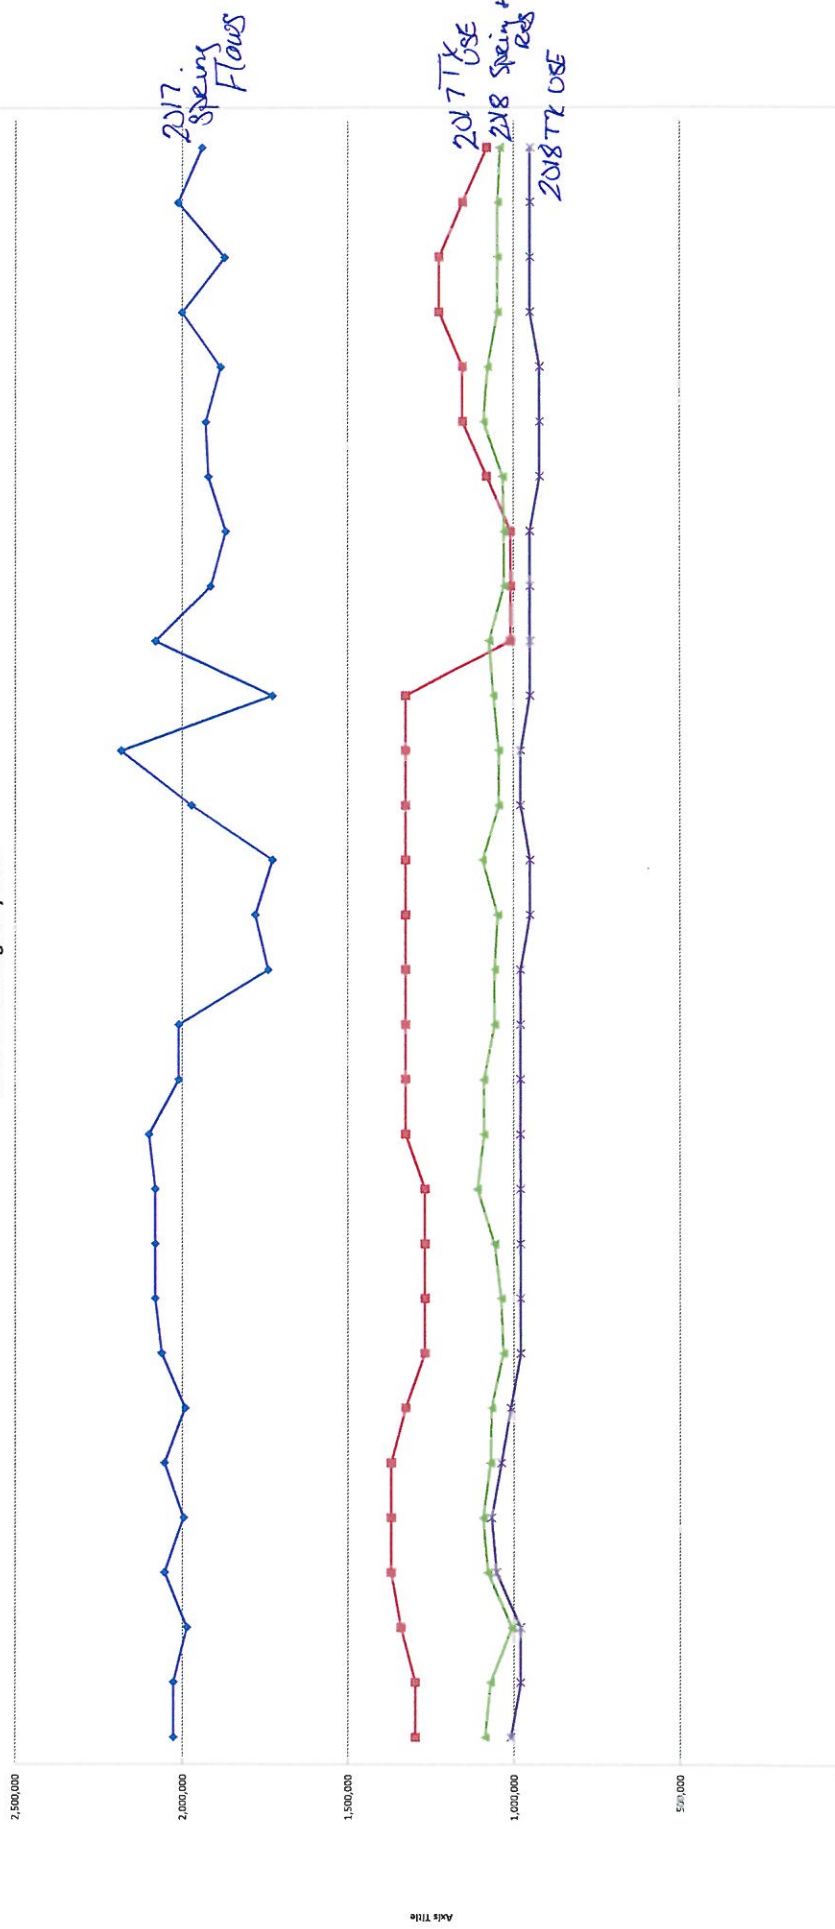

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
2017 Total Spring Flows	2,076,287	2,026,287	1,985,477	2,053,048	1,994,334	2,053,048	1,990,460	1,962,115	2,081,503	1,981,503	2,081,503	2,100,376	2,009,848	2,009,848	1,728,414	1,777,190	1,725,489	1,971,077	2,184,347	1,725,489	2,080,812	1,912,781	1,867,542	1,970,154	1,927,526	1,882,287	1,999,554	1,870,277	2,011,542	1,939,542
2017 Tx Plant Usage	1,270,000	1,296,000	1,339,200	1,368,000	1,368,000	1,368,000	1,324,800	1,267,200	1,267,200	1,267,200	1,267,200	1,324,800	1,324,800	1,324,800	1,324,800	1,324,800	1,324,800	1,324,800	1,324,800	1,324,800	1,008,000	1,008,000	1,008,000	1,008,000	1,008,000	1,152,000	1,224,000	1,224,000	1,224,000	1,180,000
2018 Spring and Res. Flows	1,085,555	1,069,678	1,055,951	1,077,051	1,091,451	1,069,114	1,066,154	1,030,920	1,037,354	1,056,753	1,108,454	1,080,454	1,089,056	1,056,753	1,056,753	1,047,341	1,097,580	1,041,837	1,043,837	1,043,837	1,060,766	1,071,192	1,177,951	1,031,656	1,088,631	1,076,705	1,047,341	1,047,341	1,037,341	1,040,878
2018 Tx Plant Usage	1,088,000	979,200	979,200	979,200	979,200	979,200	979,200	979,200	979,200	979,200	979,200	979,200	979,200	979,200	979,200	979,200	979,200	979,200	979,200	979,200	979,200	950,400	950,400	950,400	950,400	950,400	950,400	950,400	950,400	950,400

Reservoir Water is being used to supplement treatment plant usage beginning in June 2018